



NOTE:
① AUGER HOLE 4" DIAMETER X 12'-0" FILL HOLE WITH BENTONITE AND INSTALL GROUND ROD IN THE CENTER OF THE HOLE.


1 GROUND ROD DETAIL
NOT TO SCALE

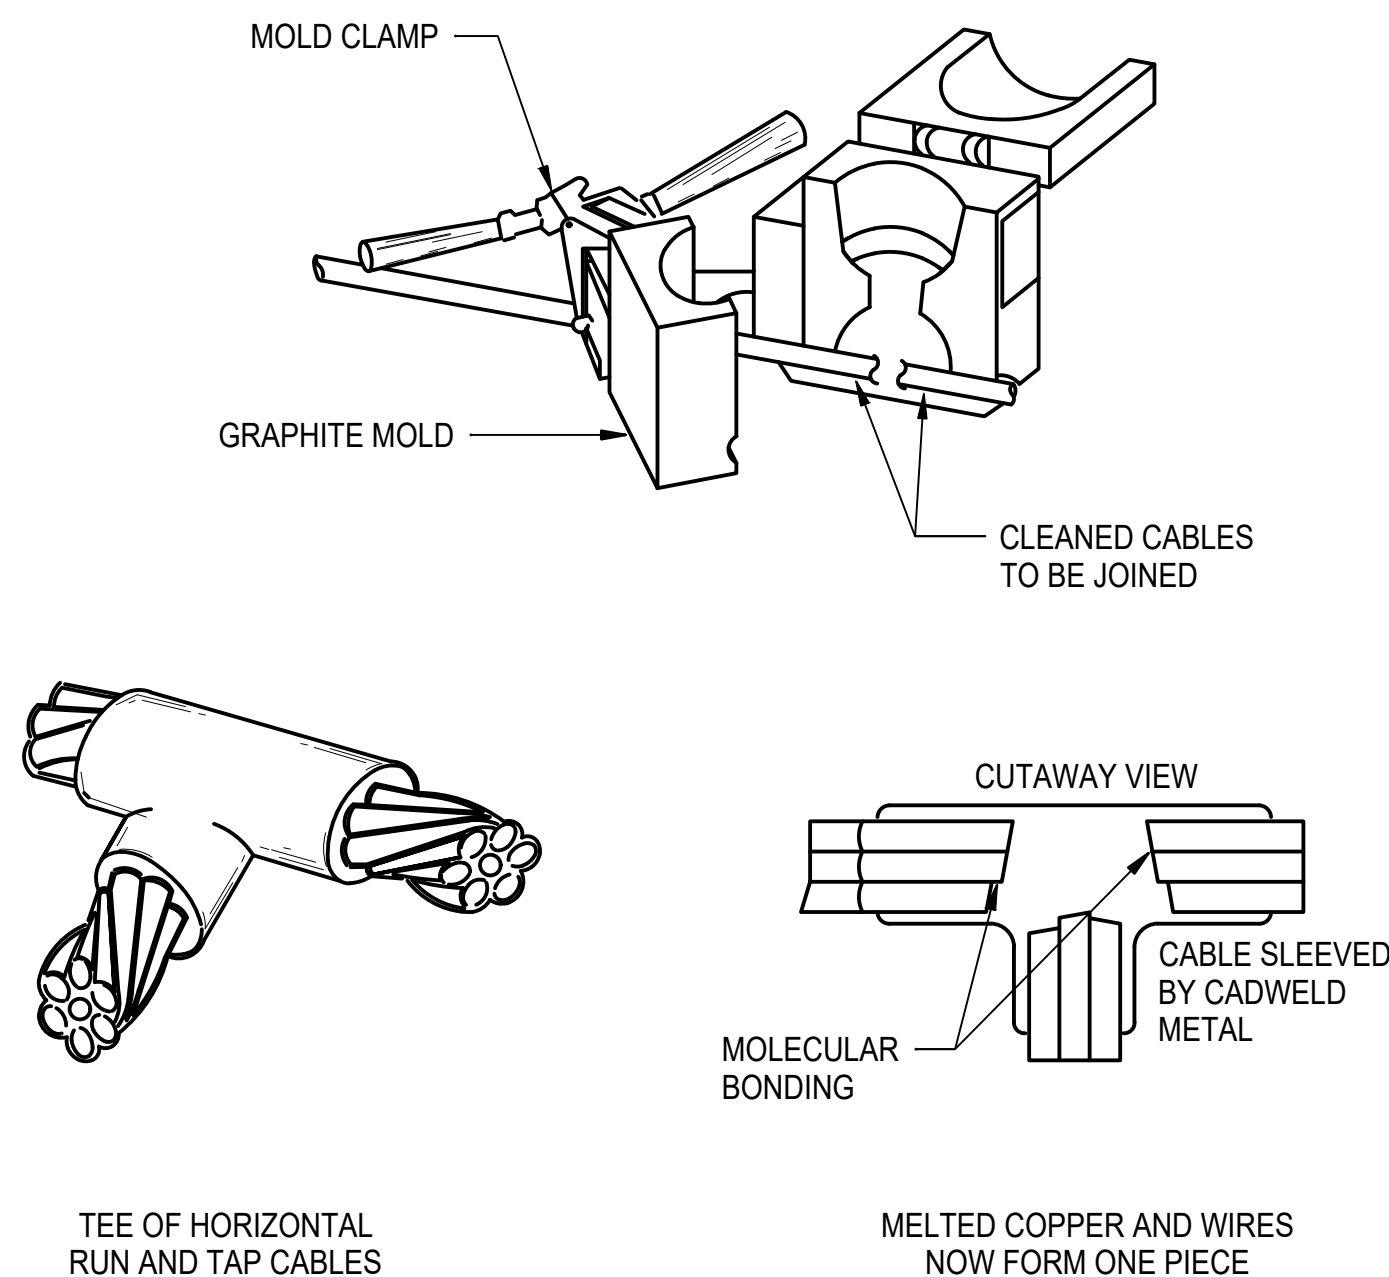

2 EXOTHERMIC WELD DETAILS
NOT TO SCALE

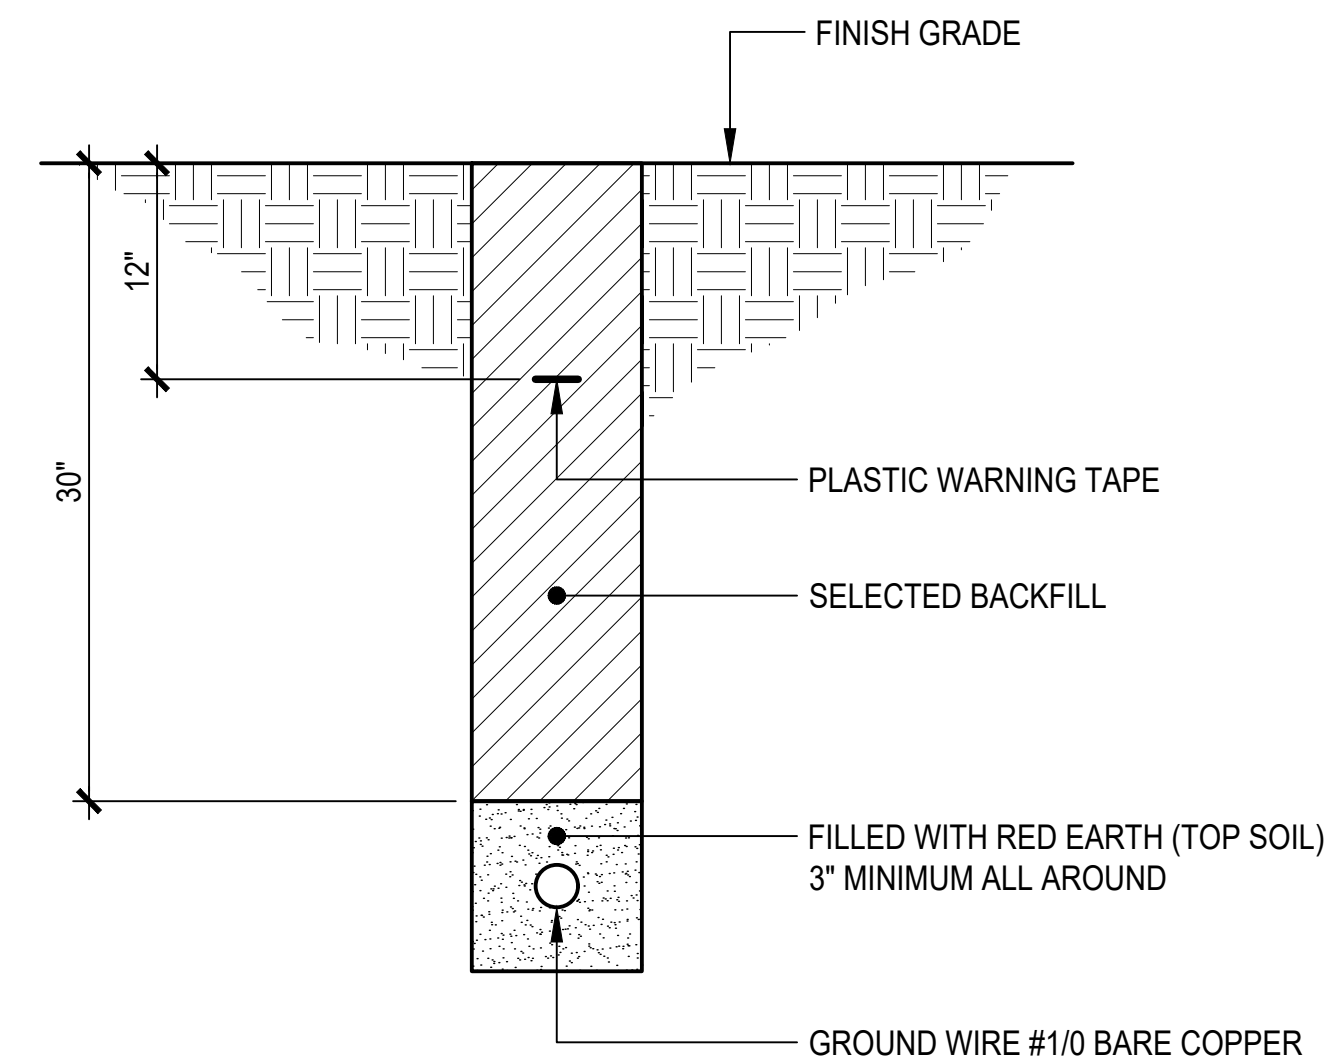


3 TRENCH SECTION FOR LPS GROUND WIRE
NOT TO SCALE

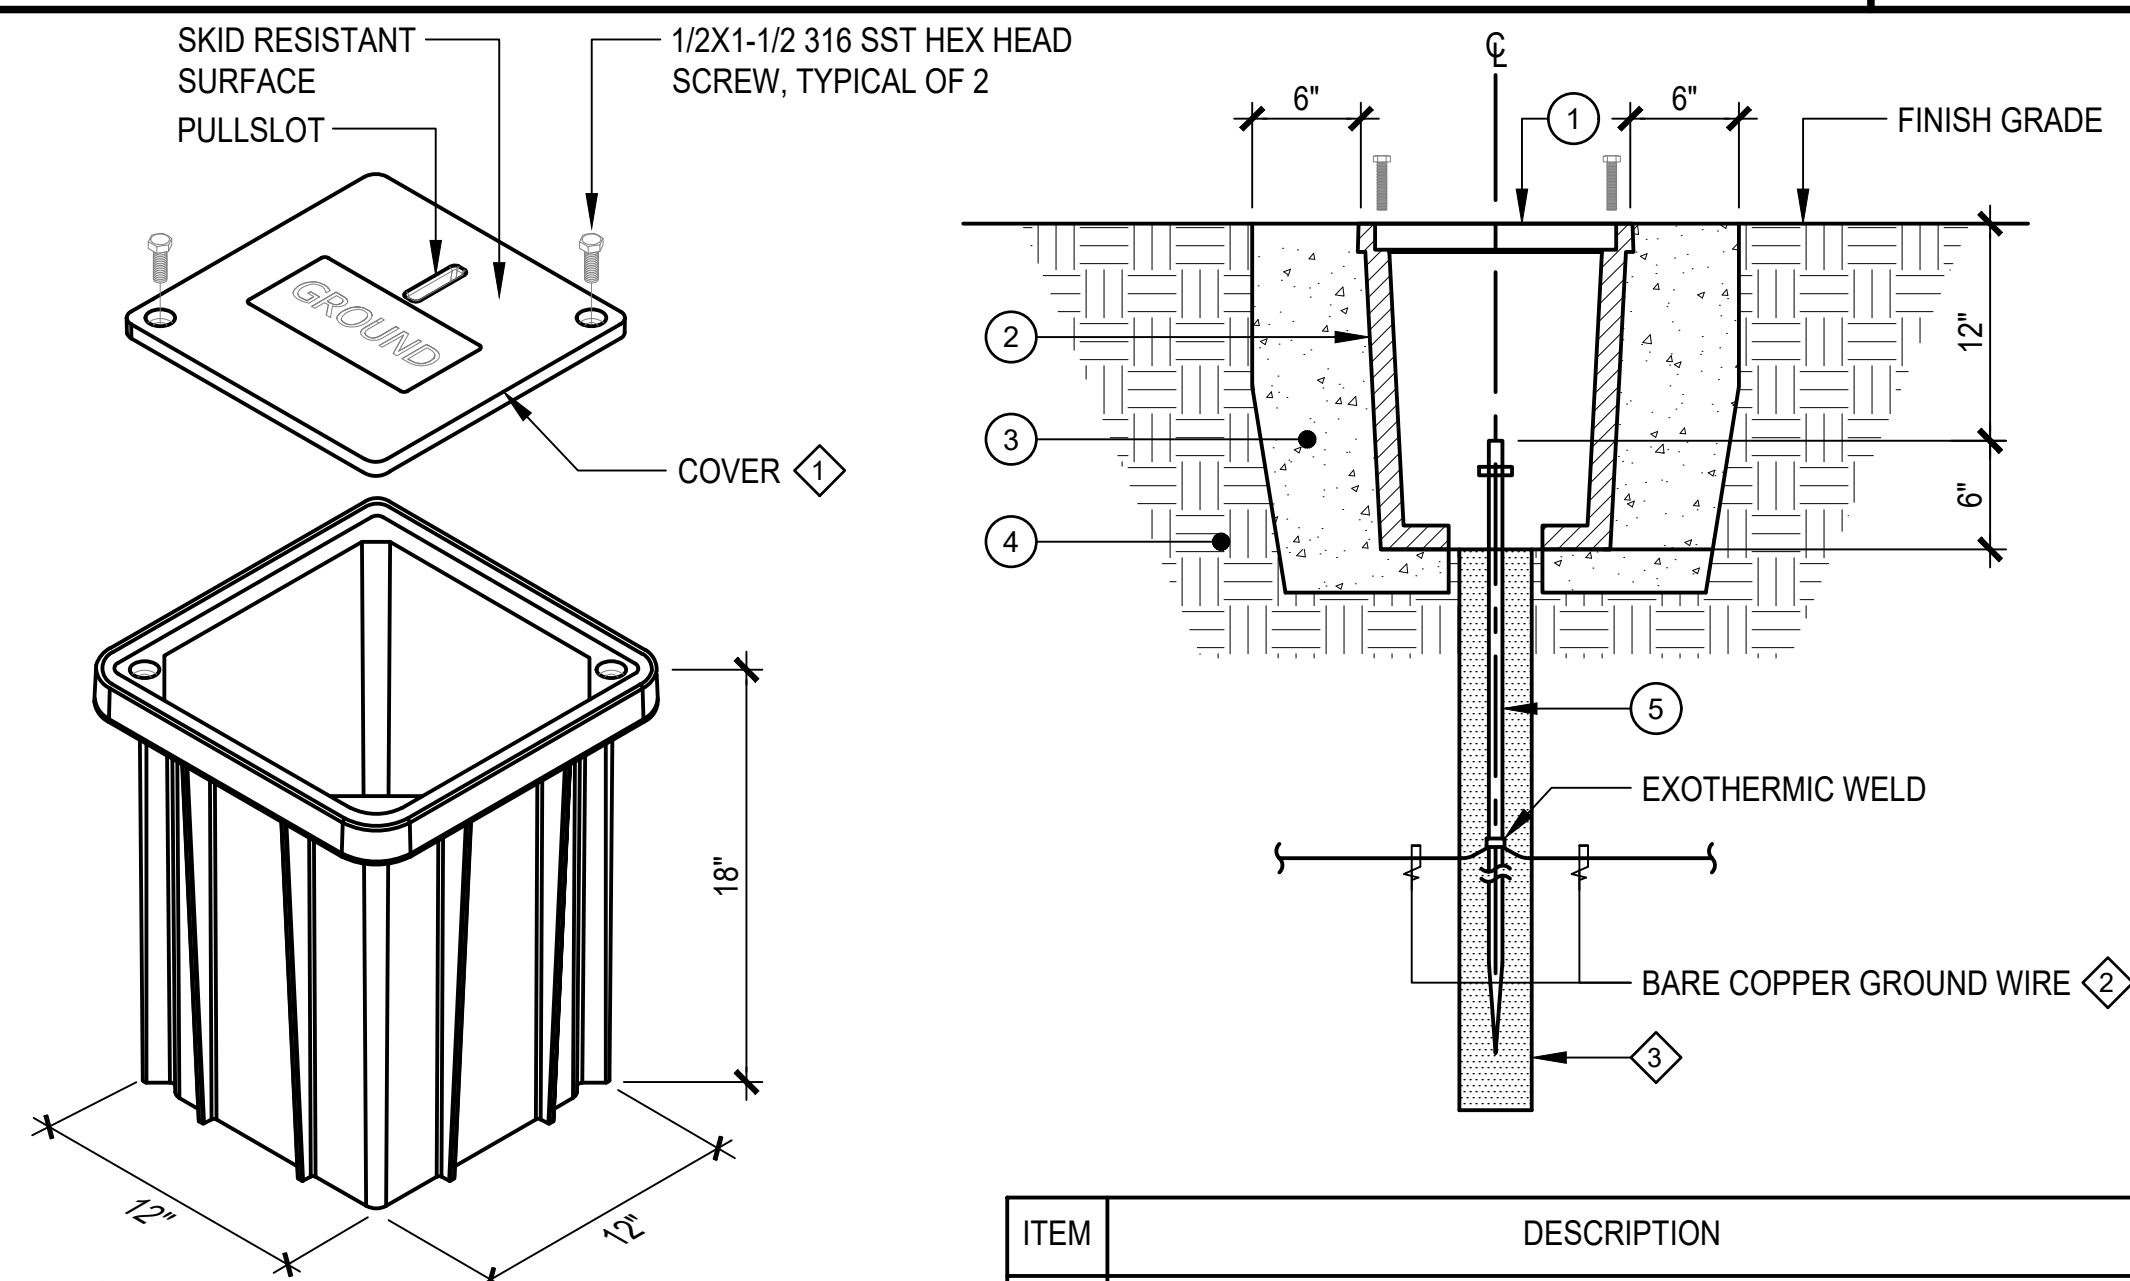


NOTES:
① TRAFFIC BEARING TYPE BOX WITH HEAVY DUTY TRAFFIC RATED POLYMER CONCRETE COVER.
② PROVIDE MECHANICAL TYPE CONNECTION WHERE LIGHTNING PROTECTION GROUNDING IS CONNECTED TO THE GROUNDING OF OTHER SYSTEMS (ELECTRICAL, COMMUNICATION, ETC.) OTHERWISE PROVIDE EXOTHERMIC WELD CONNECTIONS.
③ AUGER HOLE 4" DIAMETER X 12'-0" FILL HOLE WITH BENTONITE AND INSTALL GROUND ROD IN THE CENTER OF THE HOLE.

4 GROUND TEST WELL DETAIL
NOT TO SCALE

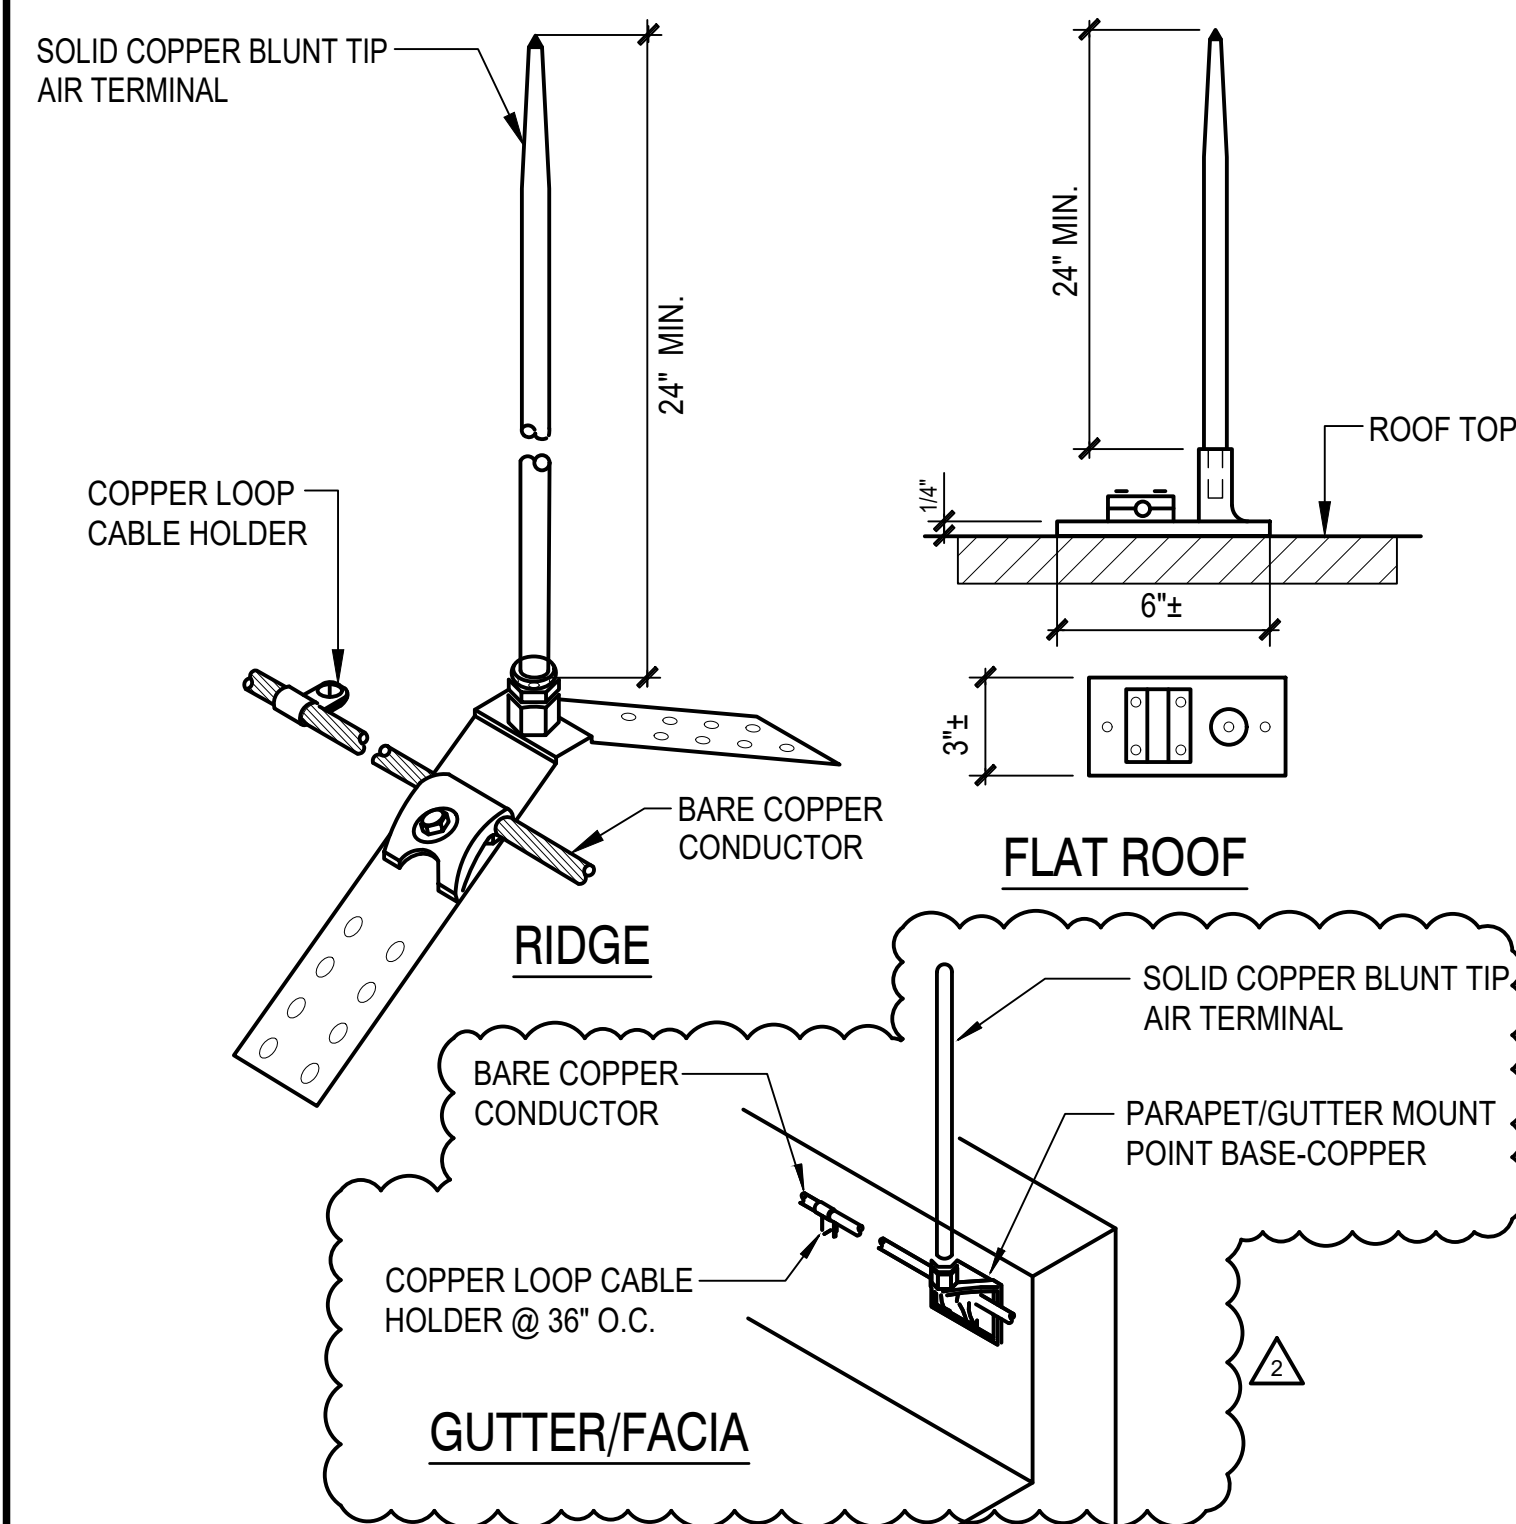

GENERAL NOTE:
① WATERPROOF ALL SCREW PENETRATING INTO ROOF PER ROOFING MANUFACTURER'S RECOMMENDATION.

5 AIR TERMINAL DETAILS
NOT TO SCALE

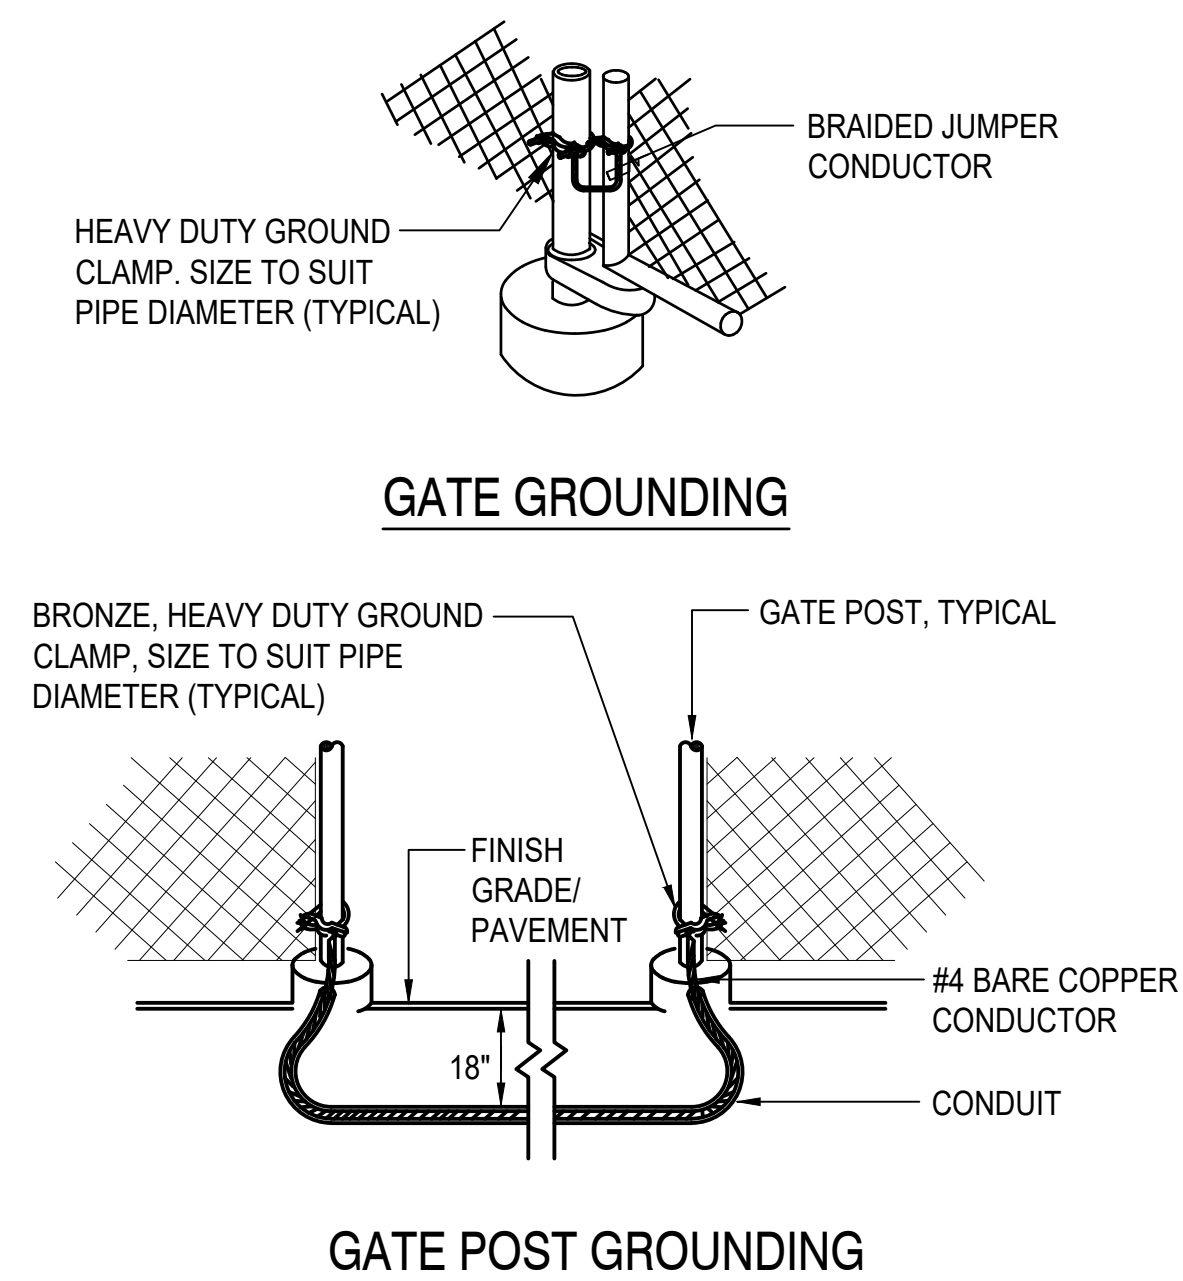


6 FENCE AND GATE GROUNDING DETAILS
NOT TO SCALE

REVISIONS		
No.	Description	Date
△	ADDENDUM 1	12/6/22
△	ADDENDUM 2	01/16/23

TRMA
Taniguchi Ruth Makio Architects
100 Cliff Business Center, P.O. Box EA, Agaña, GU 96910
Tel.: (671) 475-8772 • Fax.: (671) 472-3381

Architecture
Planning
Interior Design

EMCE
EMCE • Consulting engineers
SUITE 201, 133 ANTONIA COURT
P.O. BOX 8888 TAMUNING, GUAM 96931
671 - 649-0166/7 Phone
671 - 646-EMCE (3623) Fax

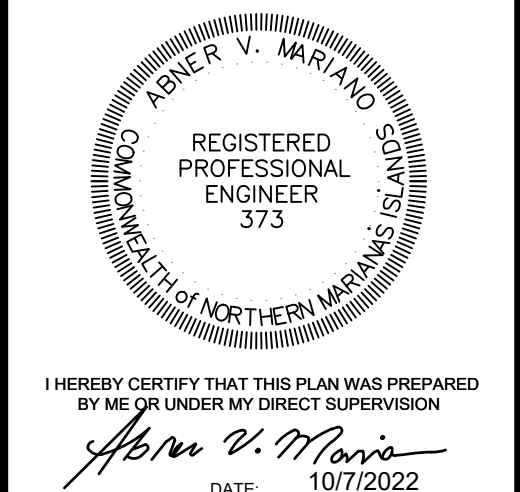

Project:
NMC
PACKAGE 1: STUDENT
CENTER BUILDING

Title:
ELECTRICAL
DETAILS - SHEET 3

CONSTRUCTION
DOCUMENTS

Designed: JF/LB
Drawn: NP/RS
Checked: IA/AM
Supv: AM
Scale: AS INDICATED
Date: 10/07/2022
Project No. File
Drawing No.

E9.3
Sheet No. of