



1 **GROUNDING BUSBAR DETAIL (IBT)**
NOT TO SCALE

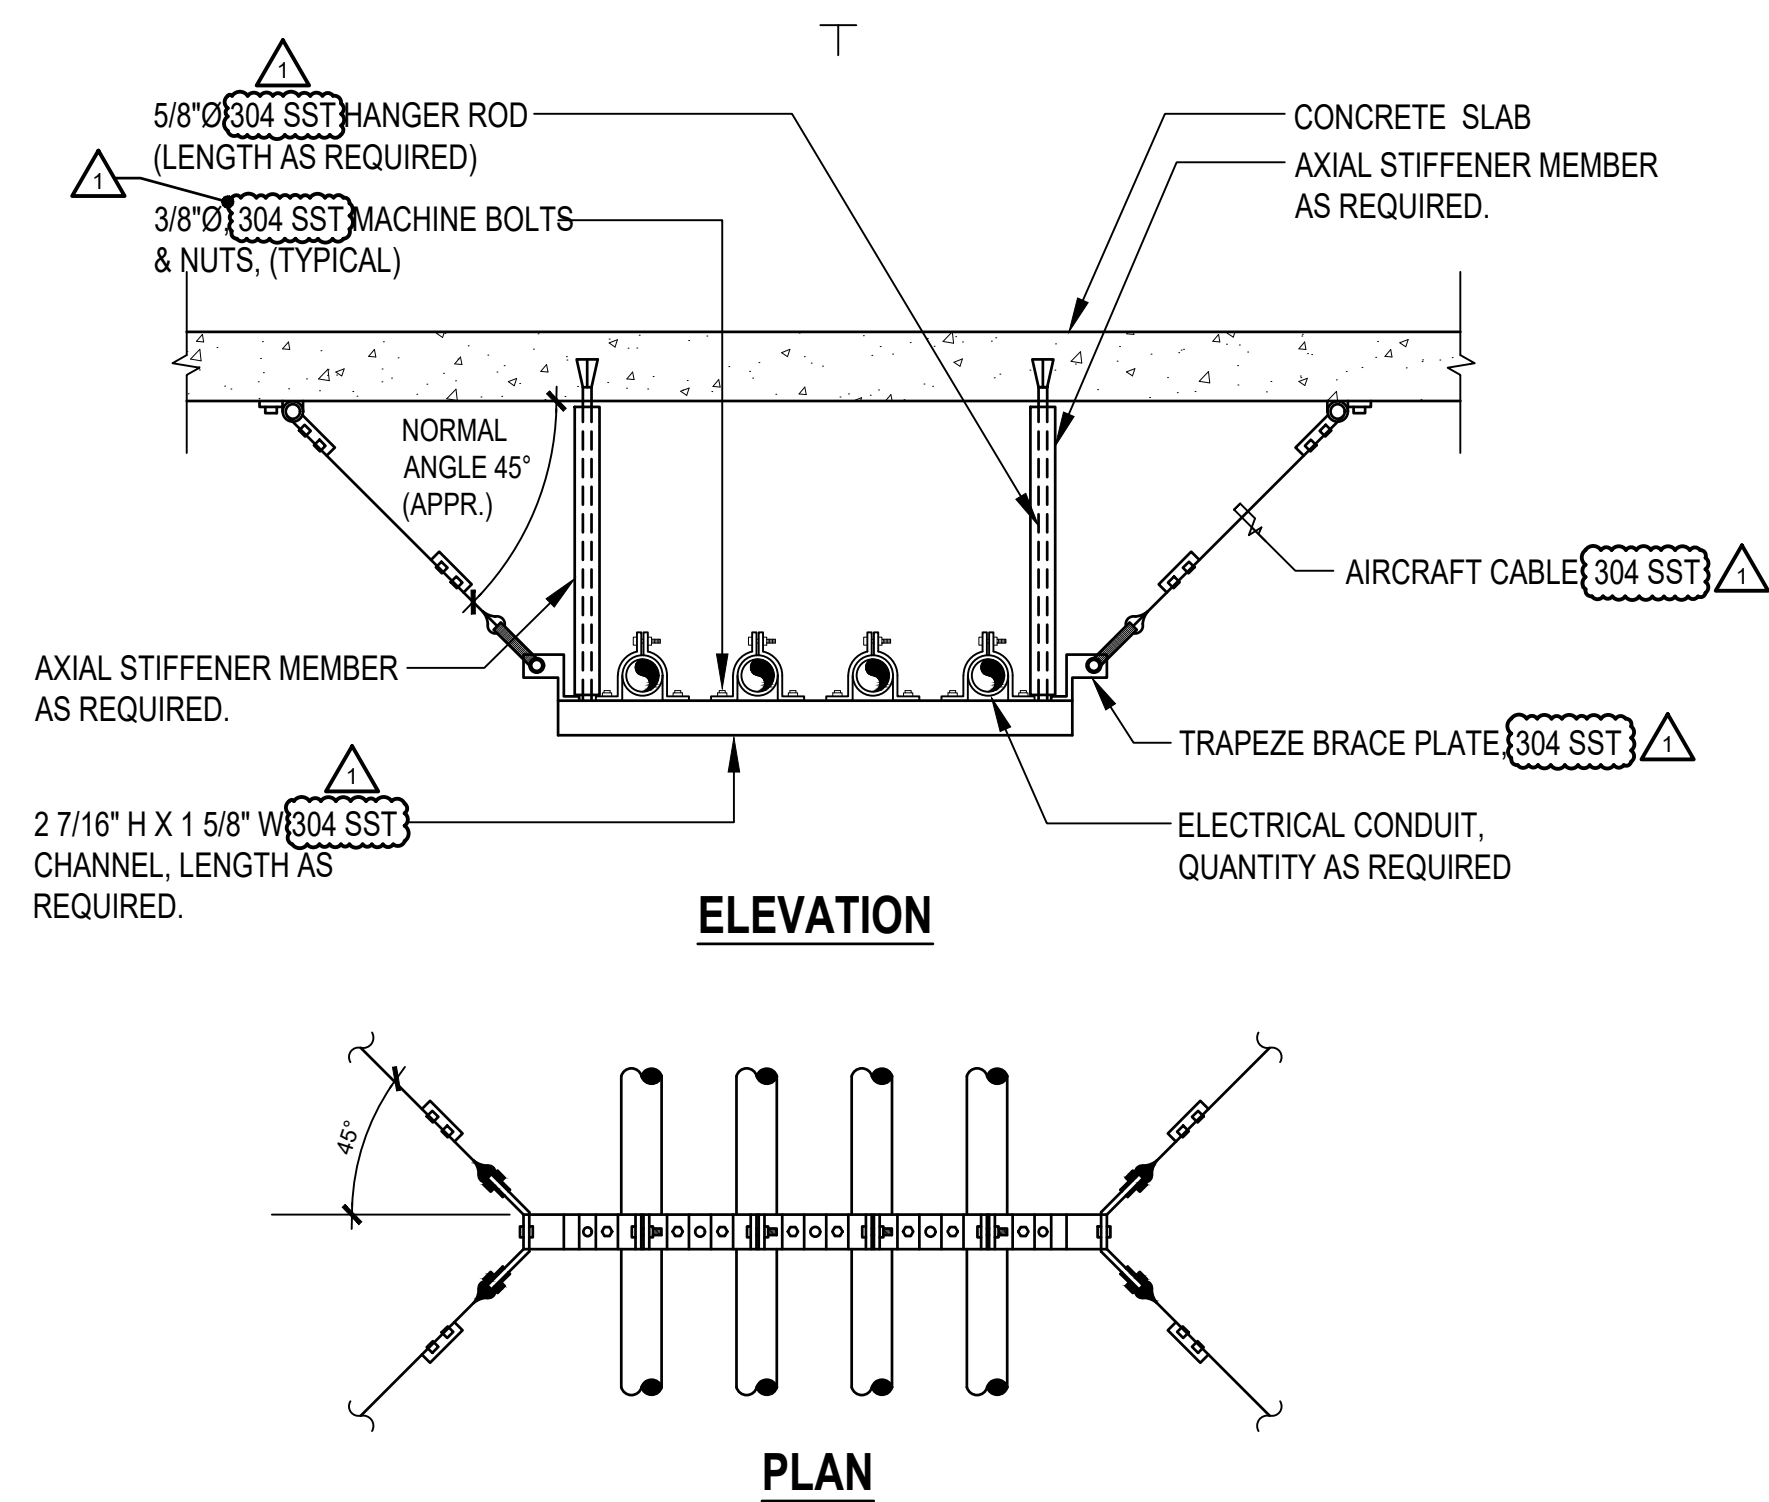

- GENERAL NOTES:
- 1 SPACING OF SEISMIC RESTRAINT IS NOT TO EXCEED 4'-0".
 - 2 WHERE INSTALLED IN AN UNCONDITIONED SPACE, ALL MATERIALS AND COMPONENTS MUST BE 304 SST.

2 **TRAPEZE CONDUIT SUPPORT DETAIL**
NOT TO SCALE

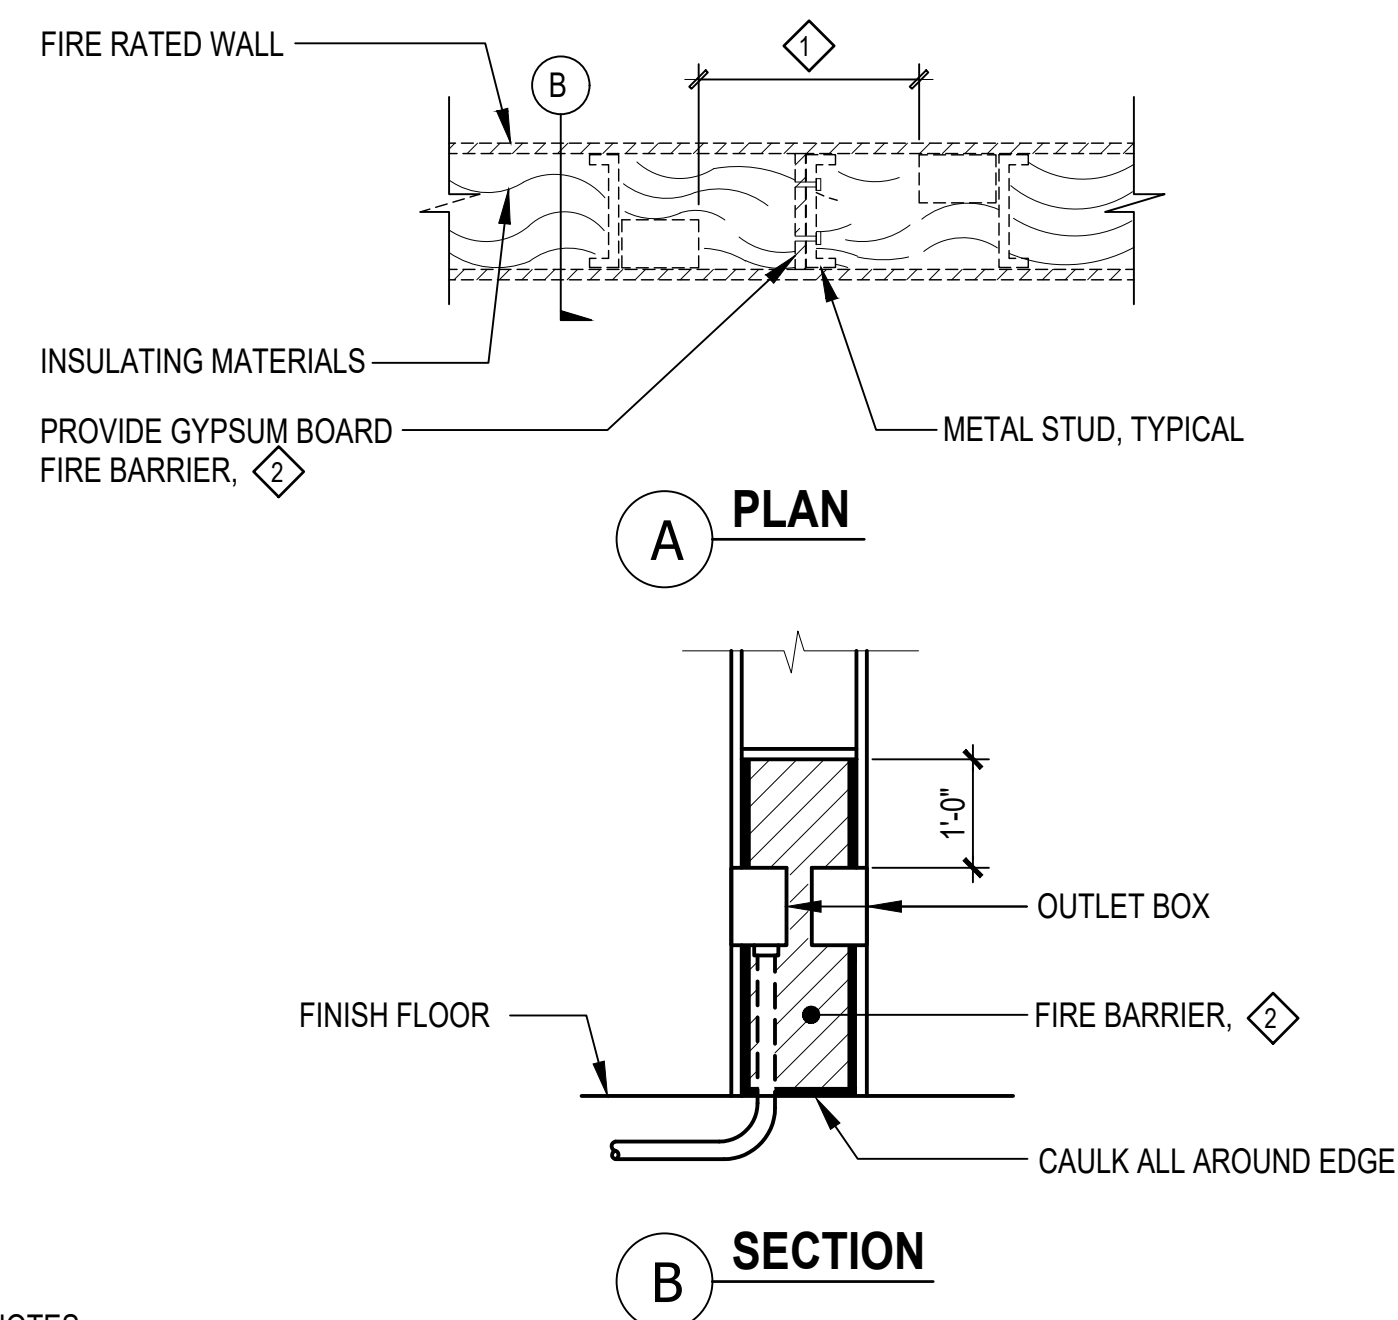

- NOTES:
- 1 MINIMUM HORIZONTAL SEPARATION MUST BE 2'-0".
 - 2 IF 2'-0" SEPARATION CANNOT BE MET A FIRE BARRIER MUST BE PROVIDED BETWEEN OUTLETS. BARRIER MATERIAL MUST BE THE SAME AS THE WALLBOARD.

3 **BACK TO BACK OUTLET MOUNTING DETAIL**
NOT TO SCALE

REVISIONS		
No.	Description	Date
1	ADDENDUM 1	12/6/22

TRMA
Taniguchi Ruth Makio Architects
100 Cliff Business Center, P.O. Box EA, Agaña, GU 96910
Tel.: (671) 475-8772 • Fax.: (671) 472-3381

Architecture
Planning
Interior Design

emce
EMCE • Consulting engineers
SUITE 201, 133 ANTONIA COURT
P.O. BOX 8888 TAMUNING, GUAM 96931
671 - 649-0166/7 Phone
671 - 646-EMCE (3623) Fax

REGISTERED
PROFESSIONAL
ENGINEER
373
I HEREBY CERTIFY THAT THIS PLAN WAS PREPARED
BY ME OR UNDER MY DIRECT SUPERVISION
Abm V. Maria
DATE: 10/7/2022

Project:
NMC
PACKAGE 1: STUDENT
CENTER BUILDING

Title:
ELECTRICAL DETAILS -
SHEET 1

CONSTRUCTION
DOCUMENTS

Designed: JF/LB
Drawn: NP/RS
Checked: IA/AM
Supv: AM
Scale: AS INDICATED
Date: 10/07/2022

Project
No. File
Drawing
No.

E9.1
Sheet No. of